



FlexLink®


Manual control device

5059071-01



Installation instruction


- Move cable end of cable 044002 from output terminal, terminal 1 to switch S31203.
- Move cable end of cable 044005 from output terminal, terminal 5 to switch S31203.
- Connect cable 201L+ to any +24V terminal on communication interface (terminal 2/terminal 6).

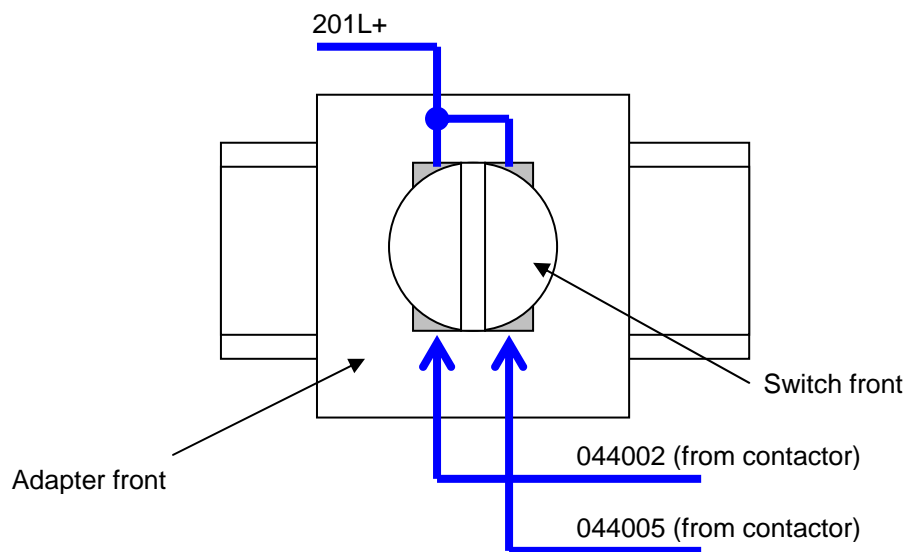

Nr.	Date	Sign	Change

FlexLink®		Department FlexLink	Drawing No. 5059071
		Customer -	
Drawn FJN	Project No. 7220283	Name Index	Sheet 100
Appr.	Date 06-04-13		Next 101

1	2	3	4	5	6	7	8
Index 100		Layouts 101 102			Circuit diagrams 312		External connections -
		Cabinet builder layouts 111					



Nr.	Date	Sign	Change



Department FlexLink
 Customer -
 Drawn FJN
 Appr.

Project No. 7220283
 Date 06-04-13

Name Layout, Exterior

Drawing No.

5059071

Sheet 101

Next 102

8

7

6

5

4

3

2

1

A

B


C

D

E

1 2 3 4 5 6 7 8

A B C D E F

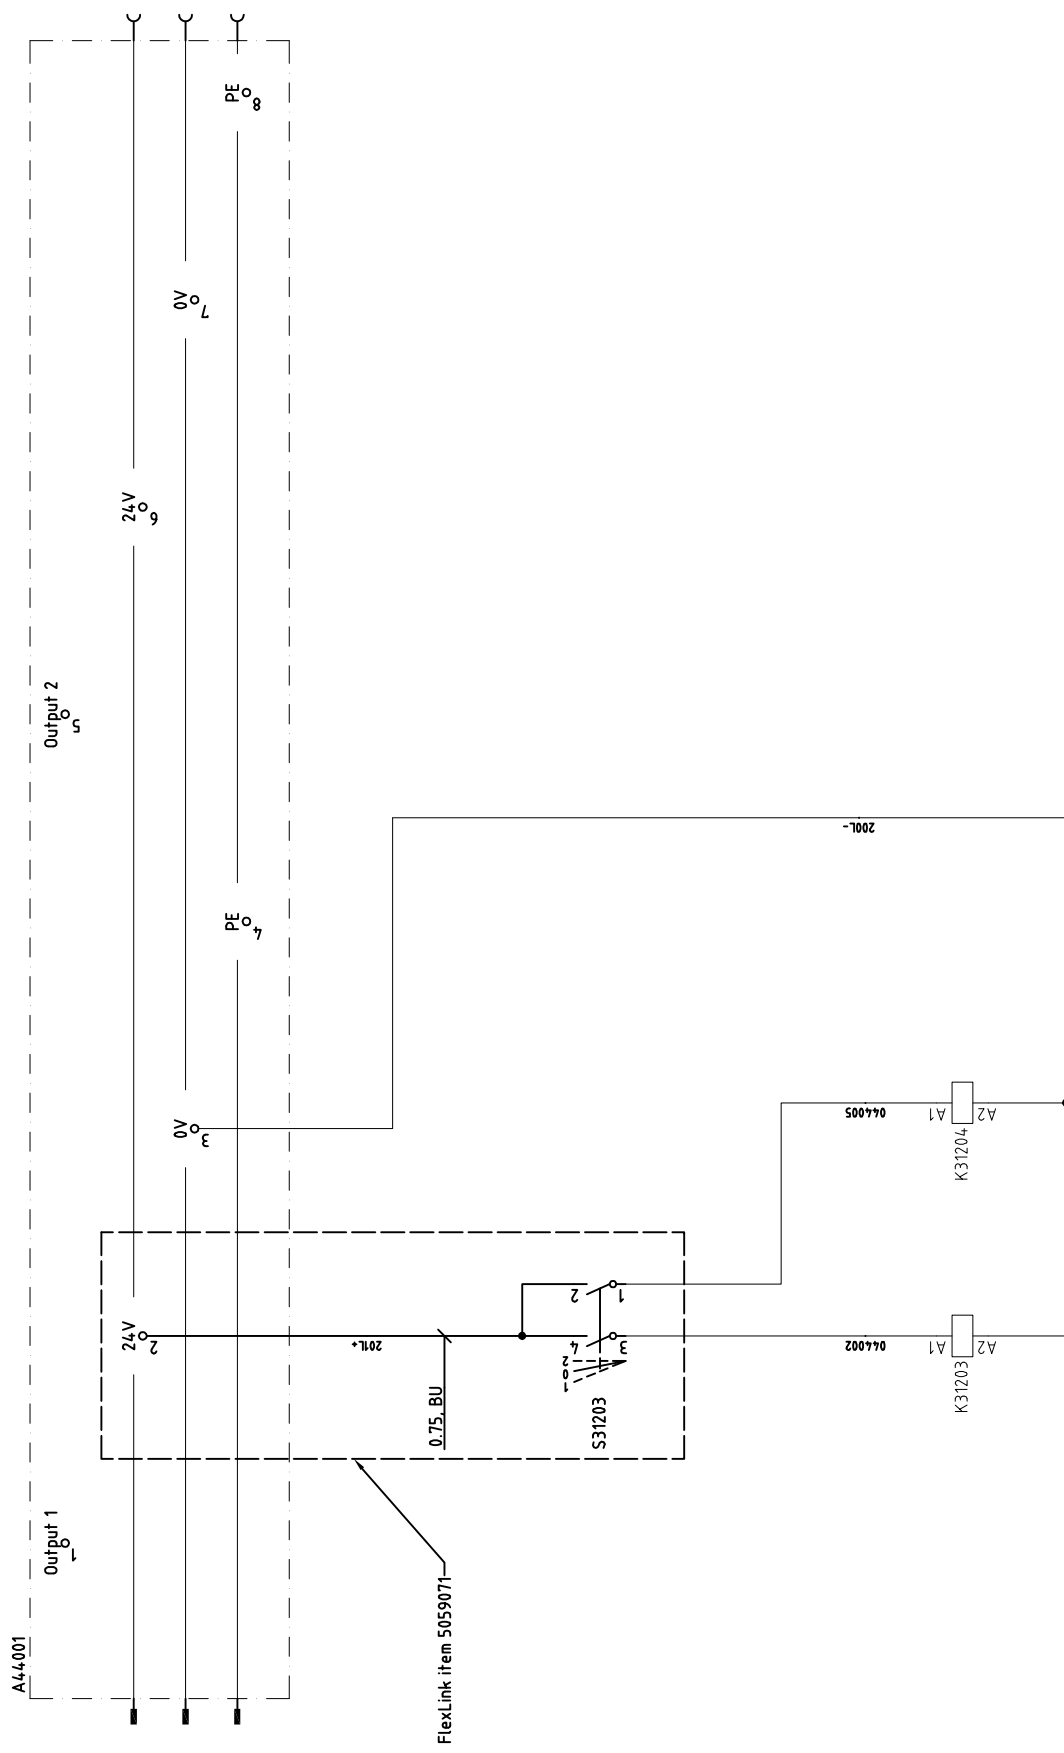

FlexLink item 5059071

Nr.	Date	Sign	Change



Department FlexLink	
Customer -	
Drawn FJN	Project No. 7220283
Appr.	Date 06-04-13

Drawing No. 5059071	
Sheet 312	Next -